
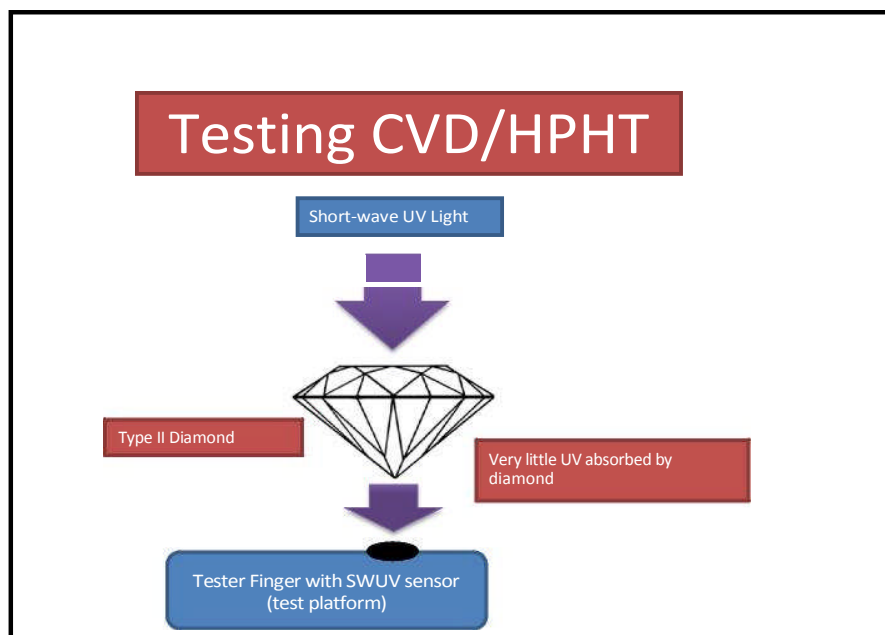


First Step: to preclude that it is not a Moissanite, for example with a SmartPro Reader I

Second Step: SMARTPRO SCREEN I TESTING CONCEPT FOR USERS

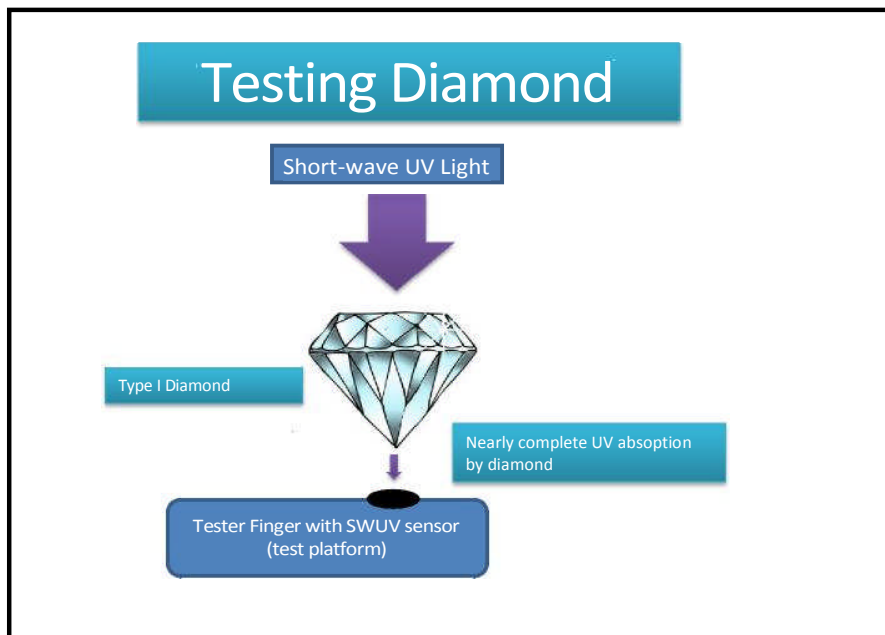

Note:

Make sure that diamond is at proper or centered position (center of hole of the finger) before testing.

If the hole is blocked by metal or any material or if the diamond is not properly placed at the test platform, it might show incorrect result. We are recommending to put the stone in proper position before testing.

Appr. 98,5% of all natural Diamonds are from Type I and appr. 1,5% are from Type II.